



S. SYMBOL

A/S, BR, NON METALLIC CABLE MAY BE USED WHERE PERMITTED BY CODE
ALL Wires DESIGNATED SHALL BE COPPER ONLY
ALL Wires DESIGNATED SHALL BE # 12 UNLESS OTHERWISE NOTED
NUMBER OF CONDUCTORS SHALL BE # TO THIRTEEN UNLESS OTHERWISE NOTED.
ALL CDS SHOWN TO BE S.O. SOCKET AND CONNECTED TO REARFIRE BATTERY UNIT WHERE APPLICABLE
PI WIRE MAY BE USED, WITH SIZES FROM 1/8 IN. DIAMETER CIRCUITS
TO BE INCLUDED IN BASE PRICE
SEE BULLETIN SO-1-70 FOR CLEARANCES

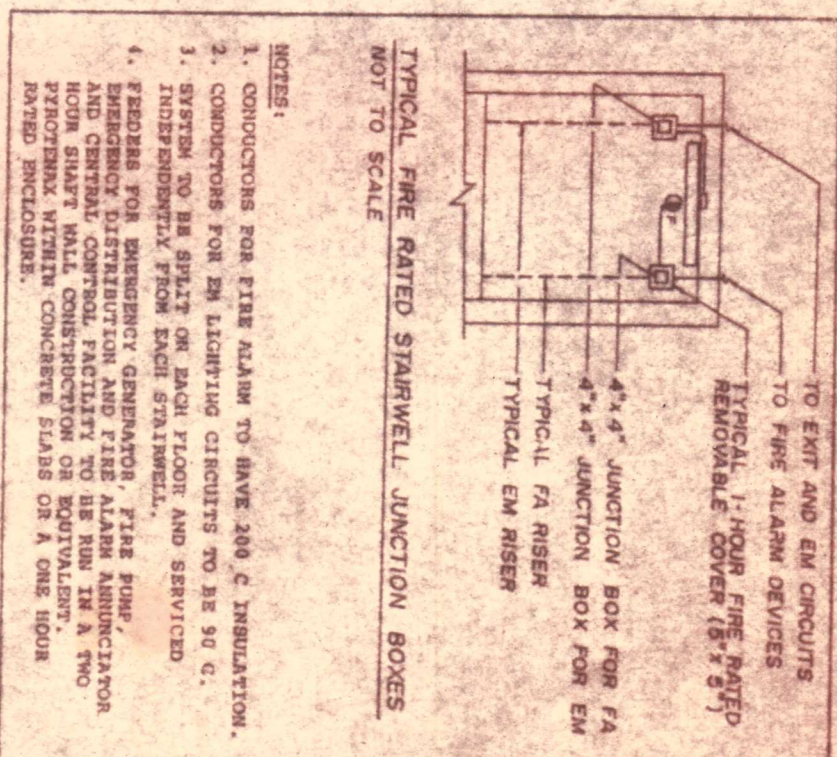

1. WIRE TO MANUFACTURER'S SPECIFICATIONS.
2. ALL CONDUITS TO BE BLOWN C/P FISH WIRE.
3. ELECTRICAL CONTRACTOR TO ALLOW _____ FOR THE SUPPLY AND INSTALLATION OF T.V. CABLE.
4. FOR EXACT NUMBER OF OUTLETS SEE BLOWN PLANS.

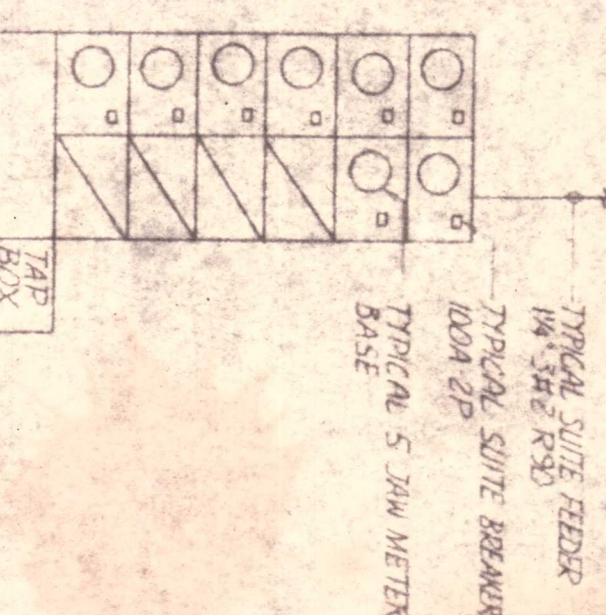

TYPICAL METER CENTRE

ELEVATOR MACHINE ROOM

ROOF

8TH FLOOR

1

10

100

1992

10

100

THE
FLOOR

GROUND FLOOR

PARKING

POWER

TELEPHONE

TELEVISION

FIRE ALARM

3411600/120/208V - 3Ø-.4W DISTRIBUTION

ONE-LINE DIAGRAM